

# PREDICTED ENERGY ASSESSMENT




Plot 25, Willingham Road,  
Market Rasen,  
Lincolnshire,  
LN8 3RE

Dwelling type: House, Detached  
Date of assessment: 23/05/2022  
Produced by: Jake Eaton  
Total floor area: 191.62 m<sup>2</sup>

This document is a Predicted Energy Assessment for properties marketed when they are incomplete. It includes a predicted energy rating which might not represent the final energy rating of the property on completion. Once the property is completed, this rating will be updated and an official Energy Performance Certificate will be created for the property. This will include more detailed information about the energy performance of the completed property.

The energy performance has been assessed using the Government approved SAP2012 methodology and is rated in terms of the energy use per square meter of floor area; the energy efficiency is based on fuel costs and the environmental impact is based on carbon dioxide (CO<sub>2</sub>) emissions.


## Energy Efficiency Rating

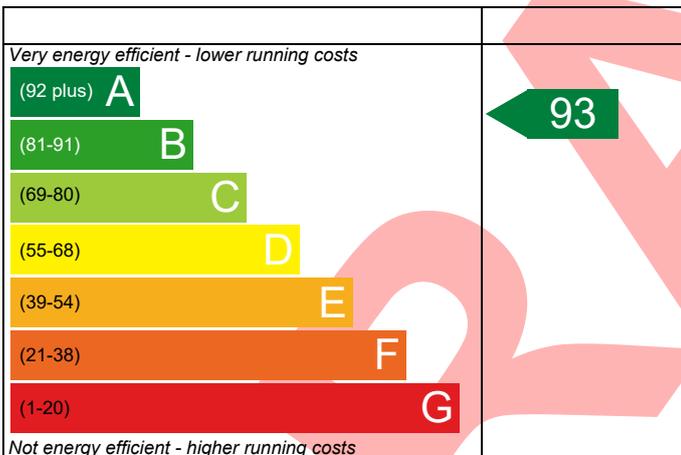

**England** EU Directive 2002/91/EC

The energy efficiency rating is a measure of the overall efficiency of a home. The higher the rating the more energy efficient the home is and the lower the fuel bills are likely to be.

## Environmental Impact (CO<sub>2</sub>) Rating

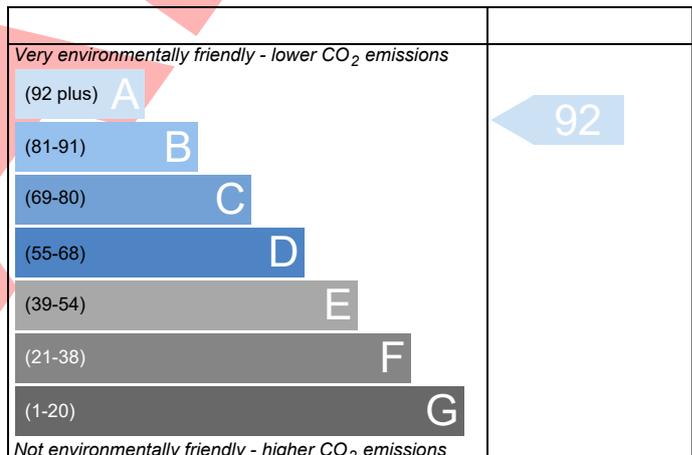

**England** EU Directive 2002/91/EC

The environmental impact rating is a measure of a home's impact on the environment in terms of carbon dioxide (CO<sub>2</sub>) emissions. The higher the rating the less impact it has on the environment.

*This report has not been submitted through the Elmhurst Energy members' portal, therefore results are subject to change when the dwelling is completed.*

# BUILDING REGULATION COMPLIANCE

## Calculation Type: New Build (As Designed)



Property Reference	LN8 3RE Plot 25	Issued on Date	23/05/2022
Assessment Reference	001	Prop Type Ref	T2
Property	Plot 25, Willingham Road, Market Rasen, Lincolnshire, LN8 3RE		

SAP Rating	93 A	DER	8.02	TER	14.71
Environmental	92 A	% DER<TER	45.48		
CO <sub>2</sub> Emissions (t/year)	1.28	DFEE	48.59	TFEE	56.12
General Requirements Compliance	Pass	% DFEE<TFEE	13.41		

Assessor Details	Mr. Jake Eaton, Jake Eaton, Tel: 01400283471, jake@aeratech.co.uk	Assessor ID	P711-0001
Client			

### SUMMARY FOR INPUT DATA FOR New Build (As Designed)

#### Criterion 1 – Achieving the TER and TFEE rate

##### 1a TER and DER

Fuel for main heating	Mains gas		
Fuel factor	1.00 (mains gas)		
Target Carbon Dioxide Emission Rate (TER)	14.71	kgCO <sub>2</sub> /m <sup>2</sup>	
Dwelling Carbon Dioxide Emission Rate (DER)	8.02	kgCO <sub>2</sub> /m <sup>2</sup>	Pass
	-6.69 (-45.5%)	kgCO <sub>2</sub> /m <sup>2</sup>	

##### 1b TFEE and DFEE

Target Fabric Energy Efficiency (TFEE)	56.12	kWh/m <sup>2</sup> /yr	
Dwelling Fabric Energy Efficiency (DFEE)	48.59	kWh/m <sup>2</sup> /yr	
	-7.5 (-13.4%)	kWh/m <sup>2</sup> /yr	Pass

#### Criterion 2 – Limits on design flexibility

##### Limiting Fabric Standards

##### 2 Fabric U-values

Element	Average	Highest	
External wall	0.25 (max. 0.30)	0.25 (max. 0.70)	Pass
Floor	0.15 (max. 0.25)	0.15 (max. 0.70)	Pass
Roof	0.10 (max. 0.20)	0.10 (max. 0.35)	Pass
Openings	1.40 (max. 2.00)	1.40 (max. 3.30)	Pass

##### 2a Thermal bridging

Thermal bridging calculated from linear thermal transmittances for each junction

##### 3 Air permeability

Air permeability at 50 pascals	5.00 (design value)	m <sup>3</sup> /(h.m <sup>2</sup> ) @ 50 Pa	
Maximum	10.0	m <sup>3</sup> /(h.m <sup>2</sup> ) @ 50 Pa	Pass

##### Limiting System Efficiencies

##### 4 Heating efficiency

This report has not been submitted through the Elmhurst Energy members' portal, therefore results are subject to change when the dwelling is completed.

# BUILDING REGULATION COMPLIANCE

## Calculation Type: New Build (As Designed)



Main heating system	Boiler system with radiators or underfloor - Mains gas Data from manufacturer rated at  Efficiency: 89.0% SEDBUK2009 Minimum: 88.0%	Pass
---------------------	--	------

Secondary heating system	Room heaters - Wood Logs Closed room heater Efficiency: 65% Minimum: 65%	Pass
--------------------------	---	------

### 5 Cylinder insulation

Hot water storage	Nominal cylinder loss: 1.62 kWh/day Permitted by DBSCG 2.10	Pass
-------------------	--	------

Primary pipework insulated	Yes	Pass
----------------------------	-----	------

### 6 Controls

Space heating controls	Time and temperature zone control	Pass
------------------------	-----------------------------------	------

Hot water controls	Cylinderstat	Pass
--------------------	--------------	------

	Independent timer for DHW	Pass
--	---------------------------	------

Boiler interlock	Yes	Pass
------------------	-----	------

### 7 Low energy lights

Percentage of fixed lights with low-energy fittings	100	%	
---	-----	---	--

Minimum	75	%	Pass
---------	----	---	------

### 8 Mechanical ventilation

Not applicable

## Criterion 3 – Limiting the effects of heat gains in summer

### 9 Summertime temperature

Overheating risk (East Pennines)	Slight	Pass
----------------------------------	--------	------

Based on:

Overshading	Average
-------------	---------

Windows facing North	10.60 m <sup>2</sup> , No overhang
----------------------	------------------------------------

Windows facing East	6.12 m <sup>2</sup> , No overhang
---------------------	-----------------------------------

Windows facing South	18.22 m <sup>2</sup> , No overhang
----------------------	------------------------------------

Windows facing West	8.33 m <sup>2</sup> , No overhang
---------------------	-----------------------------------

Air change rate	2.50 ach
-----------------	----------

Blinds/curtains	Light-coloured curtain or roller blind, closed 50% of daylight hours
-----------------	--

## Criterion 4 – Building performance consistent with DER and DFEE rate

### Air permeability and pressure testing

#### 3 Air permeability

Air permeability at 50 pascals	5.00 (design value)	m <sup>3</sup> /(h.m <sup>2</sup> ) @ 50 Pa	
--------------------------------	---------------------	---	--

Maximum	10.0	m <sup>3</sup> /(h.m <sup>2</sup> ) @ 50 Pa	Pass
---------	------	---	------

This report has not been submitted through the Elmhurst Energy members' portal, therefore results are subject to change when the dwelling is completed.

# BUILDING REGULATION COMPLIANCE

## Calculation Type: New Build (As Designed)



### 10 Key features

Roof U-value	0.10	W/m <sup>2</sup> K
Secondary heating (wood logs)	N/A	
Secondary heating fuel:	wood logs	
Photovoltaic array	2.68	kW

**DRAFT**

*This report has not been submitted through the Elmhurst Energy members' portal, therefore results are subject to change when the dwelling is completed.*